


INSTALLING THE M7547 UNIBUS KIT IN PDP-11/44 SYSTEMS

Installing M7547 Module in Computer Mounting Box

1. Turn system power off. Disconnect system line cord from 115/230 Vac wall receptacle.
2. Remove back covers from system cabinet. Turn cover locks one quarter turn clockwise and lift covers off mounting tabs.
3. Insert blade of small screwdriver into hole of mounting box latch at top-right side of computer front bezel (Figure 2-1).
4. Slide screwdriver to left and hold to release mounting box latch.
5. Grasp left drawer pull, and pull mounting box out. Release latch.

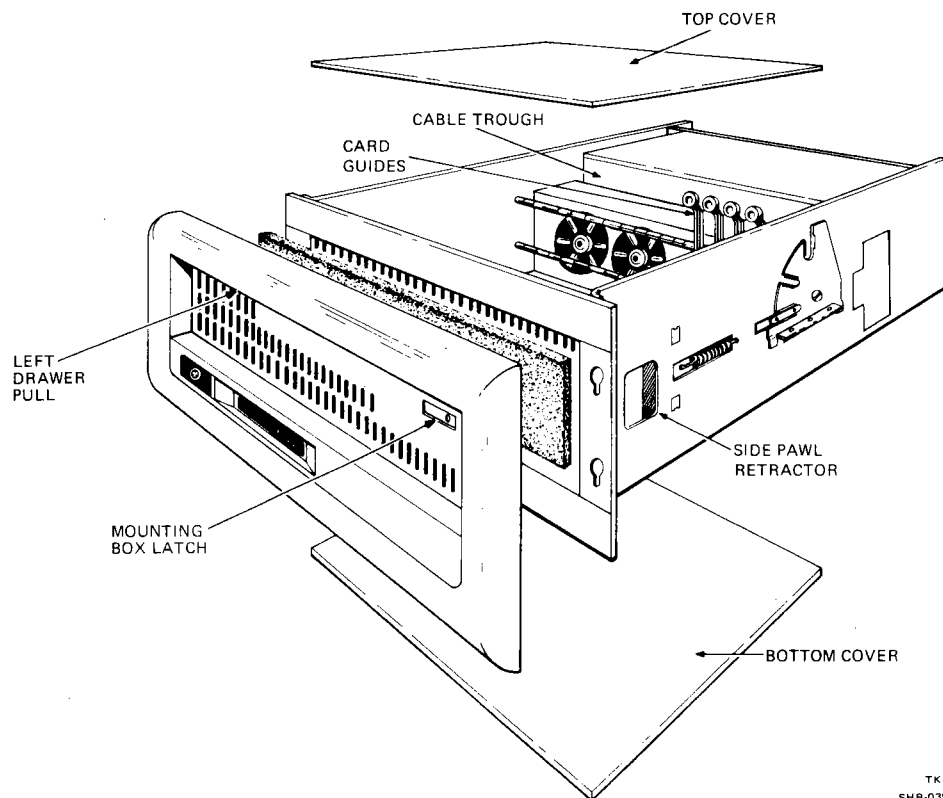

TK-4368
SHR-0393-85

Figure 2-1 PDP-11/44 Mounting Box