


REVISIONS	
ICMS	CMQ-NO
1	0822 A
2	704 B
3	00001 C

INPUT VOLTAGE	JUMPERS	LINE CONNECTIONS
100V 50 ϕ	12-9, 10-11	9-10
115V 50 ϕ	9-13, 8-10	9-10
200V 50 ϕ	11-12	9-10
215V 50 ϕ	8-12	9-10
230V 50 ϕ	8-13	9-10
120V 60 ϕ	9-12, 10-11	9-10
240V 60 ϕ	11-12	9-10
115V AUTO TAP	50 ϕ USAGE	8-9
120V AUTO TAP	60 ϕ USAGE	9-11

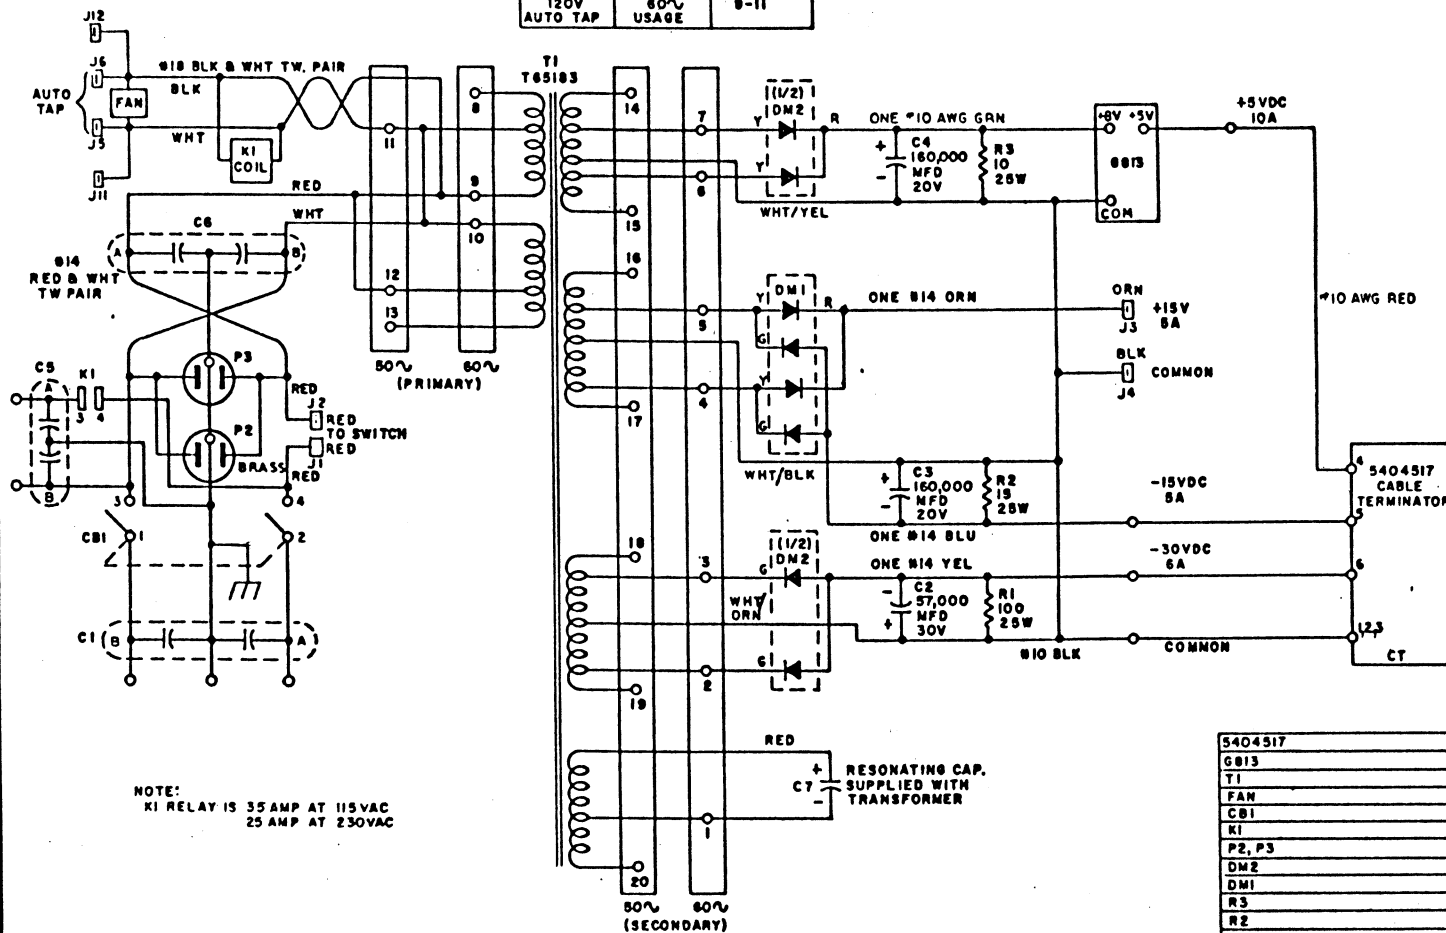

NOTE:
KI RELAY IS 35 AMP AT 115VAC
25 AMP AT 230VAC

S404517	CABLE TERMINATOR	5004318
G013	REGULATOR CONTROL	5004433
T1	TRANSFORMER T-65183	1605651
FAN	FAN-BOXER 50/60 CYCLE	1205761
CB1	CKT. BREAKER 250VAC 60CYCLE	1201218
K1	RELAY EM-1	1202260
P2, P3	PLUG 8160-5 AMPHENOL	1201252
DM2	RECTIFIER DM2 SDA10102	1105397
DM1	RECTIFIER DM1	1102933
R3	RES. 10 25W 10%WW	1300175
R2	RES. 15 25W 5% WW	1300181
R1	RES. 100 25W 5% WW	1302888
C3, C4	CAP. 160,000 MFD 20V	11004674
C2	CAP. 57,000 MFD 50V	11004875
C1, C3, C6	CAP. 1MFD 600VDC WCAF-001	11002153
	PARTS LIST	A-PL-704-O-O
REFERENCE DESIGNATION	DESCRIPTION	PART NO.

[illegible]

digital
EQUIPMENT
CORPORATION
NATURAL, MASSACHUSETTS

TITLE	PDP-8 I POWER SUPPLY 704
-------	-----------------------------

SIZE	CODE	NUMBER
C	CS	704-0-1

PINR